
257.83	REPORT OF ANNU	AL INSPECTION OF CCR	SURF	ACE	IMPO	JNDMENT	
(b) (2)	FACILITY NAME: Plant Hammond CCR Surface Impoundment AP-1, Permit 057-023D (CC OWNER/OPERATOR OF FACILITY: Georgia Power Company						
	INSPECTION DATE: October 23, 2024						
	INSPECTION DATE: October 23, 2024 INSPECTING ENGINEER: Jacob A. Jordan, P.E. (Georgia P.E. License #28586)						
(i)	ANY CHANGES IN GEOMETRY OF THE IMPOUNDING						
(i)	STRUCTURE SINCE THE PREVIOUS ANNUAL INSPECTION?				No		
	(IF YES, DESCRIBE):						
(ii)	LOCATION AND TYPE OF EXISTING INSTRUMENTATION See Attached Plan				tached Plan		
(ii)	MAXIMUM RECORDED READING OF EACH INSTRUMENT SINCE PREVIOUS ANNUAL INSPECTION See Attached Table				tached Table		
(iii)	APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF THE IMPOUNDED WATER SINCE PREVIOUS ANNUAL INSPECTION						
	MIN. DEPTH: 0 ft	MAX. DEPTH: 0 ft		ENT	T DEPTH: 0 ft ⁽¹⁾		
	MIN. ELEVATION: N/A	MAX. ELEVATION: N/A	PRES	ENT.	ELEVATI	ON: N/A	
(iii)	APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF CCR SINCE PREVIOUS ANNUAL INSPECTION.						
	MIN. DEPTH: 0 ft	MAX. DEPTH: 19 ft	PRE	SENT	DEPTH:	Up to 19 ft	
	MIN. ELEVATION: 565 ft MAX. ELEVATION: 584 ft PRESENT					ION: Up to 584	
(iv)	APPROXIMATE STORAGE CAPACITY OF IMPOUNDING STRUCTURE AT TIME OF INSPECTION. 845,000 yd ³				,000 yd ³		
(v)	APPROXIMATE VOLUME OF IMPOUNDED WATER AND CCR AT TIME OF INSPECTION		- 1	WATER: 0 yd ^{3 (1)}		CCR: 127,000 yd ³	
(vi)	ANY APPEARANCE OF AN ACTUAL OR POTENTIAL STRUCTURAL WEAKNESS OF THE CCR UNIT, IN ADDITION TO ANY EXISTING CONDITIONS THAT ARE DISRUPTING OR HAVE THE POTENTIAL TO DISRUPT THE OPERATION AND SAFETY OF THE CCR UNIT AND APPURTENANT STRUCTURES?				No		
	(IF YES, DESCRIBE):						
(vii)	ANY OTHER CHANGE(S) WHICH MAY HAVE AFFECTED THE STABILITY OR OPERATION SINCE THE PREVIOUS ANNUAL INSPECTION?				No		
	(IF YES, DESCRIBE):						

(1) Due to ongoing closure activities, stormwater may temporarily collect within AP-1 in low areas where it either evaporates or is pumped to the water treatment system.

INSTRUMENTATION PLAN PLANT HAMMOND ASH POND 1

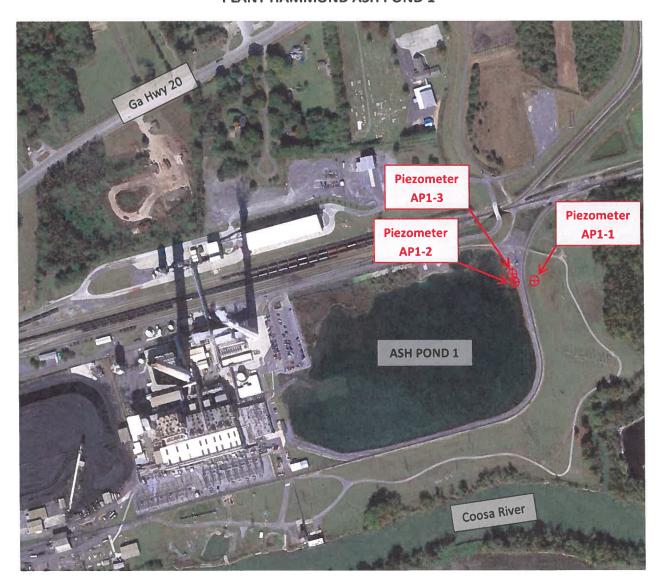

MAXIMUM RECORDED READINGS OF INSTRUMENTATION PLANT HAMMOND ASH POND 1

PIEZOMETER NUMBER	MAXIMUM RECORDED READING(1)				
AP1-1	EL 568				
AP1-2	EL 566				
AP1-3	EL 576				

(1) Maximum recorded reading since last annual inspection; rounded to the nearest foot.